


NOTES:

1. DISPERSION TRENCH SHALL BE IN ACCORDANCE WITH SECTION 210.5.
2. TRENCHES SHALL NOT BE CLOSER THAN 50 FEET TO ANOTHER (100 FEET ALONG FLOWPATH).
3. TRENCH AND GRADE BOARD SHALL BE LEVEL. ALIGN TO FOLLOW CONTOURS ON SITE.
4. TRENCH LENGTH NOT TO EXCEED 50 FEET. TRENCH LENGTH MINIMUM 10 FEET.
5. 4" X 4" PRESSURE TREATED SUPPORT POSTS SPACED 10' O.C. CLOSER SPACING MAY BE REQUIRED DEPENDING ON SOIL CONDITIONS. ALL GRADE BOARDS SHALL BE SUPPORTED BY AT LEAST FOUR PRESSURE TREATED POSTS.
6. THE VEGETATED FLOWPATH SHALL BE MEASURED FROM THE EDGE OF TRENCH. (DISCHARGE POINT) AND SHALL BE MEASURED PERPENDICULAR TO SITE CONTOURS.
7. NON-WOVEN GEOTEXTILE FABRIC TO CONFORM TO WSDOT SPEC. 9-33.2(1), TABLE 1 AND 2.
8. STRUCTURE DIRECTLY UPSTREAM OF THE DISPERSION TRENCH SHALL HAVE A FLOATABLE SEPARATOR.



GRADE BOARD NOTCH DETAIL
NTS

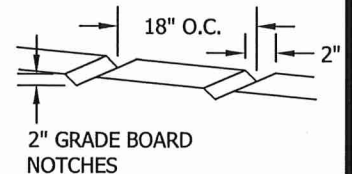

CITY OF PUYALLUP
PUBLIC WORKS AND
DEVELOPMENT ENGINEERING

APPROVED FOR PUBLICATION



DATE SEALED: 11/06/23

**DOWNSPOUT
DISPERSION TRENCH**

SCALE
NTS

DATE REVISED:
07/06/2023

CITY
STANDARD

FILE NAME: Y:\Shared\Drawings\City Standards\2018\02 - PART 2 -
STANDARD DETAILS\CAD\200\02.05.06

02.05.06